



BVVS

# Basaveshwar Engineering College, Bagalkote

[TEQIP Lead Institute, Govt. Aided Institution, AICTE Recognized, Affiliated to VTU Belagavi]

## 7.1.2: The Institution has facilities for alternate sources of energy and energy conservation measures

- |   |   |
|---|---|
| 1. Solar Energy                               | √ |
| 2. Biogas Plant                               | √ |
| 3. Wheeling to the Grid                       | √ |
| 4. Sensor-Based Energy Conservation           | √ |
| 5. Use of LED bulbs/power efficient equipment | √ |

### Options:

Any 4 or All of the above

Any 3 of the above

Any 2 of the above

Any 1 of the above

None of the above

Ans: Any 4 or All of the above

### Enclosures:

- Geo-tagged photographs
- Bills for the purchase of equipments
- Permission Document for connection to the grid Electricity Board



  
**PRINCIPAL,**  
Basaveshwar Engineering College  
**BAGALKOT**



Basaveshwar Engineering College  
BAGALKOT

# 1. Solar Energy



Fig.1: Solar-Wind Energy Park, BEC Bagalkote



Fig.2: Rooftop SPV, BEC Bagalkote

# 2. Biogas Plant

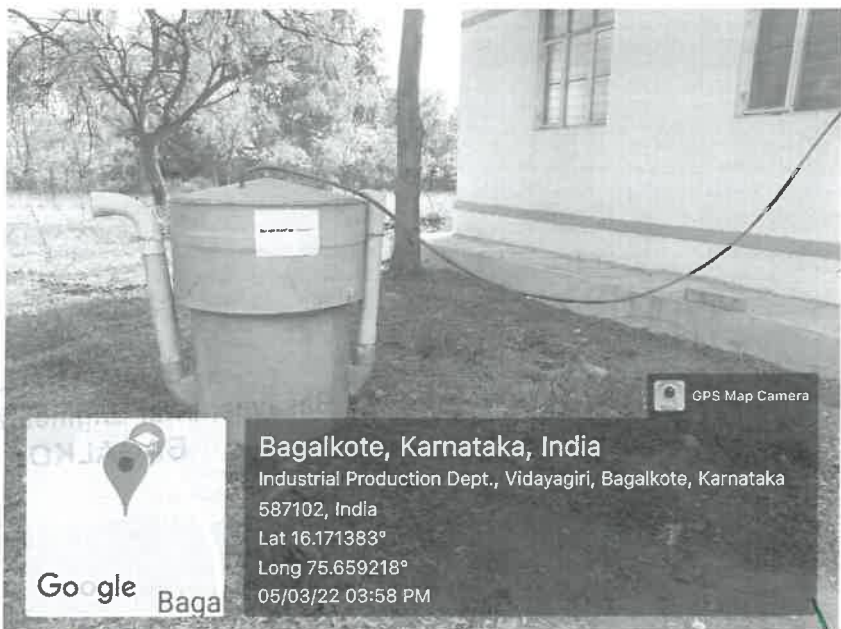


Fig.3: Biogas Plant, BEC Bagalkote



**PRINCIPAL,**  
**Basaveshwar Engineering College**  
**BAGALKOT**

## 2. Wheeling to the Grid


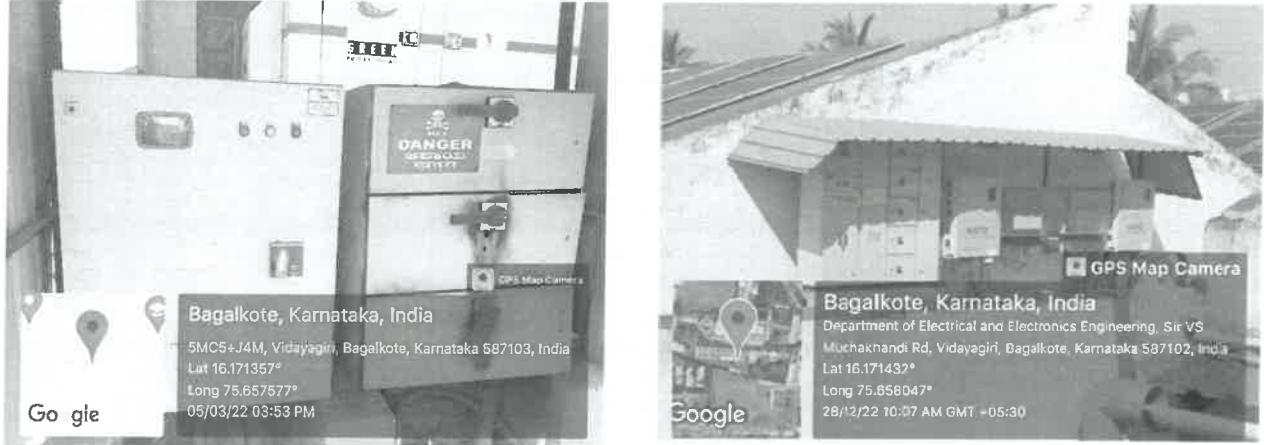


Fig.4: SPV controller & inverter integrated with Grid

## 4. Sensor-Based Energy Conservation



Fig.5: Intelligent Feeder Control Unit at DTC of BEC SCADA




*[Signature]*  
**PRINCIPAL,**  
Basaveshwar Engineering College  
BAGALKOT




**Fig.6: Intelligent Feeder Control Unit at DTC of BEC SCADA**

**6. Use of LED bulbs/power efficient equipment**

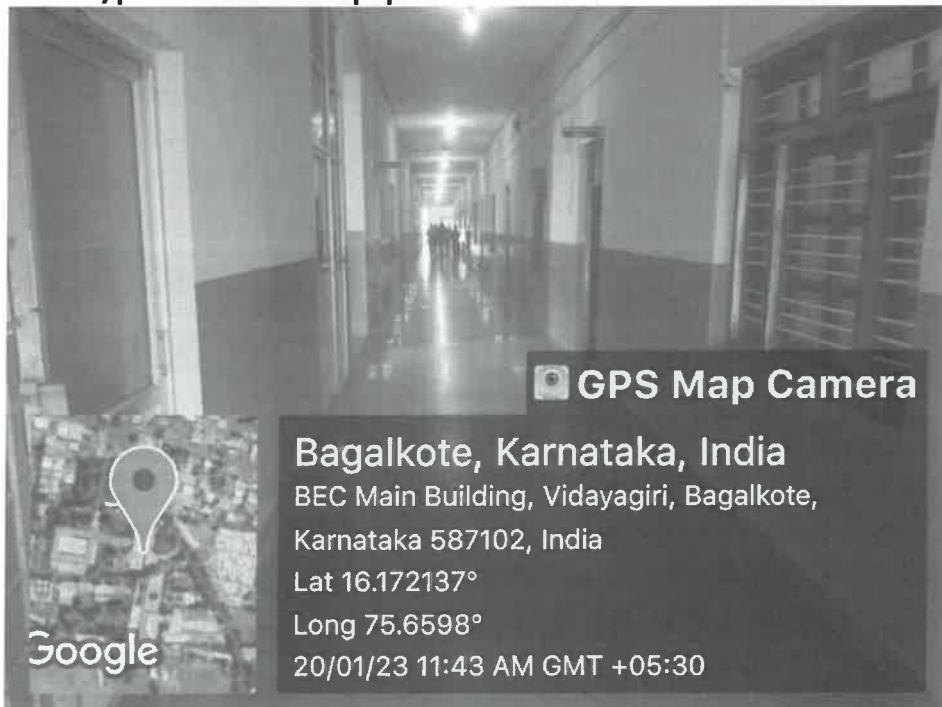


**Fig.6: LED usage at Corridor, Main Building BEC Bagalkote**

Basavasthwar Engineering College  
BAGALKOTE






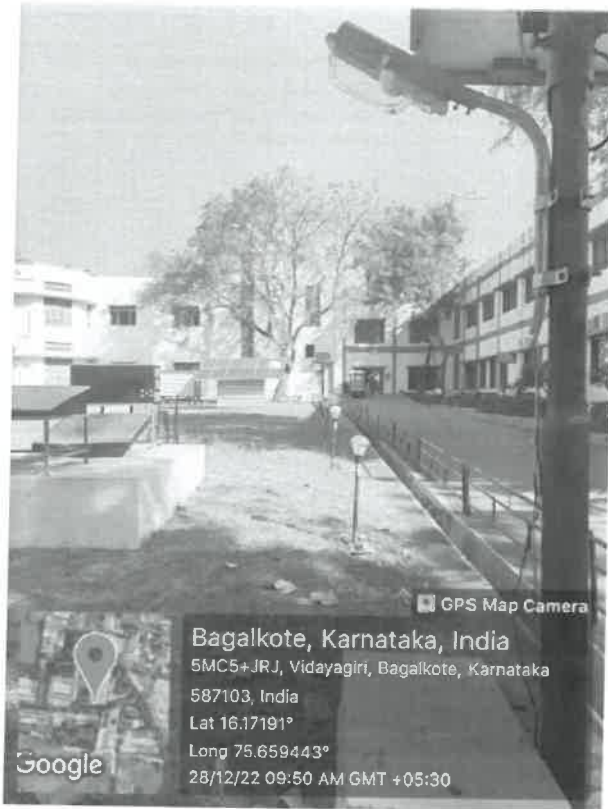

**Fig.7: LED usage at Energy Park, BEC Bagalkote**



  
**PRINCIPAL,**  
**Basaveshwar Engineering College**  
**BAGALKOT**




सत्यमेव जयते

INDIA NON JUDICIAL  
Government of Karnataka

e-Stamp

Certificate No. : IN-KA88617545022219Q  
Certificate Issued Date : 06-Feb-2018 12:04 PM  
Account Reference : NONACC (FI)/ kaksfcl08/ BELGAUM15/ KA-BL  
Unique Doc. Reference : SUBIN-KAKAKSFCL0827042708547993Q  
Purchased by : BASAVESHWAR ENGINEERING COLLEGE BAGALKOT  
Description of Document : Article 12 Bond  
Description : POWER PURCHASE AGREEMENT  
Consideration Price (Rs.) : 0  
(Zero)  
First Party : BASAVESHWAR ENGINEERING COLLEGE BAGALKOT  
Second Party : THE EXECUTIVE ENG ELE O AND M DIV HESCOM BAGALKOT  
Stamp Duty Paid By : BASAVESHWAR ENGINEERING COLLEGE BAGALKOT  
Stamp Duty Amount(Rs.) : 200  
(Two Hundred only)



Southern  
pose  
Ltd.,  
Authorised Sign

.....Please write or type below this line.....

POWER PURCHASE AGREEMENT FOR ROOFTOP SOLAR PV PLANTS  
WITH NET METERING ARRANGEMENT

This Power Purchase agreement is entered into at EE (Ele) O&M, DIVISION, and Bagalkot on this 12<sup>th</sup> Day of Feb 2018 between Hubli Electricity Supply Company Limited (HESCOM), a Government of Karnataka undertaking, a Company formed and incorporated in India under the Companies Act-1956, with its registered office located at Navanagar Hubli, Karnataka state, represented by Hubli Electricity Supply Company Limited.

Statutory Alert:



Principal,  
Basaveshwar Engineering College  
BAGALKOT

Hereinafter referred to as the "HESCOM", (which expression shall, unless repugnant to the context or meaning thereof, include its successors and permitted assigns) as party of the first part represented by Executive Engineer (Ele), O&M Division, HESCOM, Bagalkot.

AND

Basaveshwar Engineering College the consumer of HESCOM residing at Vidhyagiri Bagalkot, -587102, hereinafter referred to as the "Seller" (which expression shall, unless repugnant to the context or meaning thereof, include its successors and permitted assigns) as party of the second part.

Whereas,

- a. The Seller intends to connect and operate the Solar Roof Top Photo Voltaic (SRTPV) system with HESCOM's HT/LT Distribution system for sale of Solar Power to HESCOM in terms of the Karnataka Electricity Regulatory Commission (KERC) Order No. S/03/01 dated: 02.05.2016 as amended from time to time.
- b. The Seller intends to install a SRTPV system of 255Kwp Capacity on the existing roof top of the premises situated at Vidhyagiri Bagalkot, -587102, and bearing number (RR. No) HT-58 in the same premises under O&M City Sub-Division and O&M Division of HESCOM, Bagalkot.
- c. The Seller intends to sell net energy generated from the SRTPV system to HESCOM on net metering concept, from the date of commissioning of the SRTPV system.
- d. HESCOM intends to purchase the energy generated by such SRTPV system, on net metering concept at the tariff determined by the KERC.


Now therefore, in consideration of the foregoing premises the parties hereto, intending to be legally bound hereby agree as under:

**1. Technical and Interconnection Requirements:**

Seller shall ensure his SRTPV system complies with the following technical and interconnection requirement and shall:

- 1.1 Comply with the applicable standards and conditions in respect of integrating the SRTPV system with the distribution system.
- 1.2 Connect and operate the SRTPV system to HESCOM distribution system in accordance with the State Grid Code and Distribution Code as amended from time to time.
- 1.3 Install, prior to connection of SRTPV system to HESCOM's distribution system, an inverter with an automatic inbuilt isolation devise.
- 1.4 Provide external manual isolation mechanism with suitable locking facility so that SRTPV system will not back-feed into the HESCOM's network in case of power outage of the HESCOM's distribution system, and it shall be accessible for HESCOM to operate, if required, during maintenance/ emergency conditions.
- 1.5 Install all the equipment of SRTPV system compliant with relevant International (IEEE/IEC) and Indian standards (BIS).
- 1.6
  - a) SRTPV system shall be designed, engineered and constructed and operated by the seller or on his behalf, with reasonable diligence subject to all applicable Indian laws, rules, Regulations as amended from time to time and orders having the force of law.
  - b) The seller shall commission the SRTPV system within six months from the date of approval of PPA.
- 1.7 Adhere to the following power quality measures as per the International and Indian standards and/or such other measures stipulated by KERC/HESCOM:

Principal, Technical,  
Basaveshwar Engineering College,  
BAGALKOT.

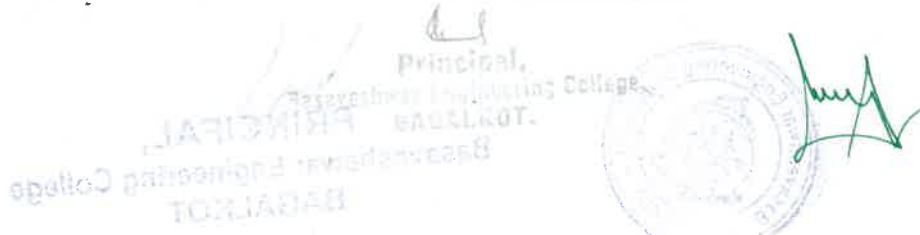

- a. Harmonic current: Harmonic current injections from a generation unit shall not exceed the limits specified in IEEE 519.
- b. Voltage at the injection point should be in the operating range of 80% to 110% of the nominal connected voltage.
- c. Flicker: Operation of Photovoltaic system shouldn't cause voltage flicker in excess of the limits stated in the relevant sections of IEC standards or other equivalent Indian standards, if any.
- d. Frequency: When the system frequency exceeds the upper limit specified in the IEGC, as amended from time to time, the SRTPV shall shift to island mode.
- e. DC Injection: Photovoltaic system should not inject DC power more than 0.5% of full rated output at the interconnection point or 1% of rated inverter output current into distribution system under any operating conditions.
- f. Power Factor: While the output of the inverter is greater than 50%, a lagging power factor of greater than 0.9 shall be maintained.
- g. The SRTPV system in the event of voltage or frequency variations must island/disconnect itself as per IEGC/KEGC Regulations within the stipulated period.

## 2. Safety:

The seller shall comply with the following safety measures:

- 2.1 The seller shall comply with the Central Electricity Authority (Measures Relating to Safety and Electricity Supply) Regulations 2010.
- 2.2 The seller shall ensure that, the design, installation, maintenance and operation of the SRTPV system are in a manner conducive to the safety of the SRTPV system as well as the HESCOM's distribution system.
- 2.3 If the Seller's SRTPV system either causes damage to and/or produces adverse effects on the other consumers' or HESCOM's assets, Seller will disconnect SRTPV system immediately from the distribution system by himself or upon directions from the HESCOM and rectify the same at his own cost before reconnection.

## 3. Clearances and Approvals

The Seller shall obtain HESCOM's and other statutory approvals and clearances before connecting the SRTPV system to the distribution system.

## 4. Access and Disconnection

- 4.1 HESCOM shall have access to metering equipment and disconnecting device of SRTPV system, both automatic and manual, at all times.
- 4.2 In emergency or outage situation, where there is no access to a disconnecting device either automatic or manual, the HESCOM shall have the right to disconnect power supply to the premise.



Principal,  
Basaveshwar Engineering College  
BAGALKOT.

  
**PRINCIPAL,**  
Basaveshwar Engineering College  
BAGALKOT



## 5. Liabilities

The Seller shall be solely responsible for availing any fiscal or other incentive provided by the State/ Central government, at his own expenses.

## 6. Commercial Settlement-

### 6.1 Tariff:

a. The HESCOM shall pay for the net energy at Rs. 4.83 per KWh as determined by the KERC in the order dated 02.05.2016 for term of this agreement. -

b. If for any reason the date of commissioning is delayed, beyond the date of commissioning agreed, the tariff payable by the HESCOM shall be lower of the :-

i) Tariff agreed to in this agreement.

OR

ii) Tariff as per the average pooled power purchase cost notified by the Commission prevailing on the date of commissioning.

Note: The seller is allowed to install SRTPV system up to 100% of sanctioned load.

c. The Seller shall pay the Electricity tax and other statutory levies, pertaining to SRTPV generation, as may be levied from time to time.

d. The Seller shall not have any claim for compensation, if the solar power generated by his SRTPV system could not be absorbed by the distribution system due to failure at power supply in grid/distribution system for reasons, such as line clear, load shedding and line faults, whatsoever.

## 7. Metering:

7.1 The seller shall arrange to shift the existing meter to the generation side of SRTPV plant to measure the solar power generation and install Bi directional meter (whole current/CT operated) at the point of interconnection to the distribution system, at a suitable place in the premises accessible for recording export of energy from the SRTPV system to the grid and import of energy to the premises of the consumer from the grid. The bi directional meter shall comply with the Central Electricity Authority (Installation and operation of meters) Regulations, 2006 and shall have the following features:

i. Separate registers for recording export and import energy with facility to download by Meter Reading Instrument (MRI).

ii. KVA, KW and KVAR measuring registers for both import and export.

iii. Meter shall have RS232 (or higher) communication optical port / Radio Frequency (RF) port to support Automatic Meter Reading (AMR).

## 8. BILLING AND PAYMENT:

8.1 HESCOM shall issue monthly electricity bill for the net metered energy on the scheduled date of meter reading.

8.2 In case, the exported energy is more than the imported energy, HESCOM shall pay for the net energy exported as per Tariff agreed in this agreement within 30 days from the date of issue of bills duly adjusting the fixed charges and electricity duty if any.

Principal,  
Basaveshwar Engineering College  
TUMAKOT

8.3 In case, the exported energy is less than the imported energy, the seller shall pay HESCOM for the net imported energy as per the prevailing retail supply tariff determined by the Commission from time to time.

8.4 HESCOM shall pay interest at the same rates as is being levied on the consumers for late payment charges in case of any delay beyond 30 days period from the date of issue of bill payment, for Net energy exported.

**Explanation: Net metered energy means the difference of meter readings of energy injected by the SRTPV system into the grid (export) and the energy drawn from the grid for use by the seller (import) recorded in the bi-directional meter.**

#### **9. Term and Termination of the Agreement**

9.1 This agreement shall be in force for a period of 25 years from the date of commissioning of the SRTPV system unless terminated otherwise as provided here under.

9.2 If the HESCOM commits any breach of the terms of agreement, the seller shall serve a written notice specifying the breach and calling upon the HESCOM to remedy/rectify the same within 30 days or at such a period and at the expiry of 30 days or such other period from the delivery of the notice. Seller may terminate the agreement by delivering the termination notice. If the HESCOM fails to remedy/rectify the same.

9.3 If the Seller commits any breach of the terms of the Agreement, HESCOM shall serve a written notice specifying the breach and calling upon the seller to remedy/ rectify the same within 30 (thirty) days or at such other period and at the expiry of 30 (Thirty) days or such other period from the delivery of the notice, HESCOM may terminate the agreement by delivering the termination notice, if the seller fails to remedy/ rectify the same.

9.4 Upon termination of this Agreement, seller shall disconnect the SRTPV system from the distribution system and intimate the same to HESCOM.

#### **10. Dispute Resolution:**

All the disputes between the parties arising out of or in connection with this agreement shall be first tried to be settled through mutual negotiation.

The parties shall resolve the dispute in good faith and in equitable manner.







In case of failure to resolve the dispute, either of the parties may approach the appropriate Forum of law.


  
Principal,  
Basaveshwar Engineering College  
BAGALKOT.



  
**PRINCIPAL,**  
**Basaveshwar Engineering College**  
**BAGALKOT**

IN WITNESS WHEREOF, the Seller and the HESCOM have entered into this Agreement executed on the date and year first set forth above.

For AND ON BEHALF OF Hubli Electricity Supply Company Limited	For AND ON BEHALF OF SELLER
<p style="text-align: center;"></p> <p>By: (Name) Executive Engineer (Ele) Designation: O &amp; M Division HESCOM Address: BAGALKOT.</p>	<p style="text-align: center;"> Principal, Basaveshwar Engineering College BAGALKOT.</p> <p>By: Basaveshwar Engineering College Bagalkot</p> <p>RR No: HT-58 Address: Vidhyagiri Bagalkot, -587102</p>
<p>WITNESS In Presence of Name: Designation:</p> <p style="text-align: center;"> Asst. Ex. Engr. (EI) O &amp; M CSD, HESCOM BAGALKOT.</p>	<p>WITNESS In Presence of Name:</p> <p style="text-align: center;"> R. G. PATIL. Bus. Engr. College. Bagalkot.</p>
<p>WITNESS In Presence of Name: Designation:</p> <p style="text-align: center;"> Asst. Engineer (Tech) O &amp; M, City Sub-Division HESCOM, BAGALKOT</p>	<p>WITNESS In Presence of Name:</p> <p style="text-align: center;"> Anpal Suryaji Hande. B.E. (Electrical &amp; Electronics Engg)</p>




  
Principal,  
Basaveshwar Engineering College  
BAGALKOT



# SHRI BASAVA ENTERPRISES

2

TAX INVOICE				
<b>SHRI BASAVA ENTERPRISES</b> Sector No 4, Navanagar Bagalkot -587103 Bagalkot(Dist) GSTIN: 29BBNPP2185C1ZE Mob +91 9901666956	Invoice No	81	Dated	15.11.2021
	Delivery Note	Na	Mode Terms of Payment	cash
	Supplier's Ref.		Other reference(s)	
	Terams of Delivery			
<b>Buyer</b> The Principal, Basaveshwar Engineering College, (Autonomous) Bagalkot - 587102	Buyer's Order PO No	81	Dated	15.11.2021
	Despatch Document No		Dated	
	Despatched through		Destination	
	Terams of Delivery			
Description of Goods	HSN/SAC	Quantity	Rate	Amount
Solar PV Panels 180WP 12V Mono Crystalline	84.19.X	6.00	11220.24	67321.43
Net Value				67321.43
Output CGST 6%				4039.29
Output SGST 6%				4039.29
Approximation Round Off				
<b>Grand Total</b>				<b>75400.00</b>
Amount Chargabale (in words)				E & O.E
Seventy Five Thousand Four Hundred Only				
Declaration				
emission reduction rights associated with the installation and use of the company's product and services" we declare that this invoice shows the actual price of the goods declared and that all the particulars are true and correct				<b>SHRI BASAVA ENTERPRISES</b>  Authorised Signatory



  
**PRINCIPAL,**  
 Basaveshwar Engineering College  
 BAGALKOT



# HRI BASAVA ENTERPRISES

## TAX INVOICE

<b>HRI BASAVA ENTERPRISES</b> Sector No 4, Navanagar Bagalkot -587103 Bagalkot(Dist) GSTIN: 29BBNPP2185C1ZE Mob +91 9901666956	Invoice No <b>80</b>	Dated <b>15/11/2021</b>
	Delivery Note <b>Na</b>	Mode Terms of Payment <b>cash</b>
	Supplier's Ref.	Other reference(s)
<b>Buyer</b> The Principal, Basaveshwar Engineering College, (Autonomous) Bagalkot - 587102	Buyer's Order PO No <b>80</b>	Dated <b>15/11/2021</b>
	Despatch Document No	Dated
	Despatched through	Destination
Terms of Delivery		

Description of Goods	HSN/SAC	Quantity	Rate	Amount
Solar PV Panels 150WP 12V Poly Crystalline	84.19.X	6.00	8169.64	49017.86
Net Value				49017.86
Output CGST 6%				2941.07
Output SGST 6%				2941.07
Approximation Round Off				
<b>Grand Total</b>				<b>54900.00</b>

Amount Chargable (in words)  
**Fifty Four Thousand Nine Hundred Only**

E & O.E

**Declaration**

emission reduction rights associated with the installation and use of the company's product and services" we declare that this invoice shows the actual price of the goods declared and that all the particulars are true and correct

**SHRI BASAVA ENTERPRISES**  
  
 Authorized Signatory



*(Handwritten Signature)*  
**PRINCIPAL,**  
**Basaveshwar Engineering College**  
**BAGALKOT**



ಕರ್ನಾಟಕ ರಾಜ್ಯ ಜೈವಿಕ ಐಂಧನ ಅಭಿವೃದ್ಧಿ ಮಂಡಳಿ  
Karnataka State Bio Fuel Development Board

Ref: KSBDB/IDC-Bio/CR-22/2012-13/ 16೨೩

Date: 01.02.2013

To,

All the Co-ordinators of  
District Bio fuel Information and Demonstration Centres.

Sir,

Sub: Installation of bio gas unit in I & D Centre - reg.

\*\*\*\*\*

The Karnataka State Bio fuel Development Board has taken the initiative to upgrade all the district Biofuel Information and Demonstration centres with installation of latest pre fabricated portable model of Bio gas units. Your centre will be provided with such an unit that could be used for demonstration, R & D and for utilizing the gas for day to day activities. It is requested to identify suitable place measuring 5' x 5' at ground level in open area anywhere around the I & D centre for installation. It is also requested to make arrangement for 20 to 25 buckets of fresh cow dung for initial feed of the unit during the time of installation. The slurry obtained by this bio gas may be used as manure for garden, raising of biofuel plantation or growing vegetables.

M/s Synod Bio science who are entrusted with the assignment of installation of bio gas units will be in touch with you for necessary assistance. It is requested to extend all the co operation in getting the unit installed at your centre. Once delivered, you may please take the unit under stock. You will be provided with a user manual as well as hands on training by the unit provider at your location. You may feel free to seek any additional information in this regard from Smt. Sheetal Singh, Research & Development Officer, Karnataka State Bio fuel Development Board, Bangalore.

Thanking you,

Yours faithfully,

*Basavaraaj*  
(Basavaraaj)  
Technical Officer 1/2/13

Copy to the:

1. Mr. Zeeshan, Synod bio science (P) Ltd., Ganappa Complex, Millers Road, Vasanth nagar, Bangalore - 560 058 for information and necessary action.
2. Office copy.

ಕರ್ನಾಟಕ ರಾಜ್ಯ ಜೈವಿಕ ಐಂಧನ ಅಭಿವೃದ್ಧಿ ಮಂಡಳಿ

Flat: 116, 8th Cross, Railway Parallel Road, Kumbura Park West, Bangalore - 560 020  
Tel: 080-23502109. Email: 080-23502100 www.biofuelkarnataka.com



*Basaveshwar*  
**PRINCIPAL,**  
Basaveshwar Engineering College  
BAGALKOT

TIN: 32041826919 (C)

CSI No: 32041826919 (c)

Synod Bio Science  
Ezhupunna South P.O. Cherthala, Alappuzha Mob.No.9037877870

**THE KERALA VALUE ADDED TAX RULES, 2005  
FORM NO. 8**

(For Customers when input tax credit is not required)  
[See rule 58(10)]

**RETAIL INVOICE  
CASH / CREDIT**

(To be Prepared in Duplicate \*)

Date: 22-02-2013

INVOICE No. 1098

Name & Address of the purchaser with TIN, if any: The Managing Director, Karnataka state biofuel Development board Bangalore

Delivered at: Dr. Bharathi S Meti Prof. And HOD, Dept of biotechnology, basaveshwara Engg. college PB#53, S. Nijalingappa vedhya nagar, Dagalkote-587102, Bagalkote dist.

Telephone: 08354234060 Mobile: 9448972628

Fax:

e-mail:

S	Schl Entry No.	commodity	HS N code	Rate Of tax	Unit price	Qty	value	Exc ise dut y	Gro ss Val ue	C as h Di sc ou nt	Net Taxable value	tax	total	Qty d isco unt
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
		Bio Plants Gas Holder			22333.00	1 No	22333.00				22333.00		22333.00	
		5% Vat Collected 8B		5%								1116.66	1116.66	
		Round Off												
						1 No	22333.00				22333.00	1116.66	23450.00	

**TOTAL IN WORDS RS: Twenty Three Thousand Four Hundred And Fifty Only**

E&OE  
Terms of Delivery and payment if any

**DECLARATION**

(To be furnished by the seller)

Certified that all the particulars shown in the above Tax Invoice are true and correct and that my/our Registration under KVAT Act 2003 is valid as on the date of this Bill.

657475/c  
12.19


Authorized Signatory  
(with stamp & seal)



2023/1/17 12:14

*[Handwritten signature]*



 <b>POWER RESEARCH &amp; DEVELOPMENT CONSULTANTS PRIVATE LIMITED,</b> # 5 11th Cross, 2nd Stage, West of Chord Road, Bangalore - 560 086 Tel: +91-80-23192159 23192168 23192209 Fax: 23192210 E-mail : prdc@vsnl.com KST : 71628873 CST : 71678876 } dtd 6-5-95 CIN No:U72200KA1994PTC015487 Employee's Provident Fund Code No.KN/BN/19905 SERVICE TAX Regn. No.: AABCP3291JST001 IEC N.: 0703013891 PERMANENT A/c No. : AABCP3291J TIN No: 29340028246 Dtd:01.04.2003	<b>INVOICE</b>  <b>INVOICE NO: 23216</b> <b>DATE: 31.08.2016</b>
--	---

**Basaveswara Engineering College (Autonomus)**  
 Vidyanagar, Bagalkot - 587 102  
 Karnataka

P.O. NUMBER	P.O. DATE	D.C. NO.	D.C. DATE	NATURE OF JOB
TEQIP- II/2016/KA2G06/Shopping/150	24.08.2016			MATERIAL SUPPLY

SL.NO.	DESCRIPTION	QTY	UNIT PRICE	AMOUNT IN INR
1	<b>Grid Tie Inverter with FCU, Installation &amp; Configuration</b>	1	1,62,300.00	1,62,300.00

<b>NARRATION :</b> 1. 100% of the Order Value (Rs.1,62,300/-) Delivery and Installation 2. VAT at 14.5 % Extra	<b>SUBTOTAL</b>	<b>1,62,300.00</b>
	<b>VAT @ 14.5%</b>	<b>23,534.00</b>
	<b>TOTAL</b>	<b>1,85,834.00</b>

**In Words: One Lakh Eighty Five Thousand Eight Hundred Thirty Four Only**

**TERMS :**

1. Make all DDs payable to : Power Research & Development Consultants Private Limited, Bangalore.
2. 24% Interest is applicable if the bill is not cleared within 15 days.

**Our Bank Account Details**

**IFSC CODE:** CNRB0000886  
**Beneficiary's Bank:** Canara Bank, Mahalakshmi Layout branch, Bangalore - 86  
**Beneficiary's Account Number:** 0886261010300  
**Beneficiary's Account Name:** Power Research & Development Consultants Pvt. Ltd.  
**Beneficiary's Address:** #5, 11th Cross, West of Chord Road, II Stage, Bangalore - 560086, Karnataka, INDIA

Prepared by 

Checked by 

for POWER RESEARCH & DEVELOPMENT  
CONSULTANTS PVT LTD.



**PRINCIPAL,**  
**Basaveshwar Engineering College**  
**BAGALKOT**





**POWER RESEARCH & DEVELOPMENT  
CONSULTANTS PRIVATE LIMITED,**

# 5 11th Cross, 2nd Stage, West of Chord Road, Bangalore - 560 086  
Tel +91-80-23192159, 23192168, 23192209 Fax: 23192210  
E-mail : prdc@vsnl.com  
KST : 71628873  
CST : 71678876 }dtd 6-5-95  
CIN No:U72200KA1994PTC015487  
Employee's Provident Fund Code No.KN/BN/19905  
SERVICE TAX Regn. No.: AABCP3291JST001  
IEC N.: 0703013891  
PERMANENT A/c No. : AABCP3291J  
TIN No: 29340028246 Dtd:01.04.2003

**INVOICE**

**INVOICE NO: 23216  
DATE: 31.08.2016**

**SECOND COPY**

**Basaveswara Engineering College (Autonomus)**  
Vidyanagar, Bagalkot - 587 102  
Karnataka

P.O. NUMBER	P.O.DATE	D.C. NO.	D.C.DATE	NATURE OF JOB
TEQIP- II/2016/KA2G06/Shopping/150	24.08.2016			MATERIAL SUPPLY

SL.NO.	DESCRIPTION	QTY	UNIT PRICE	AMOUNT IN INR
1	<b>Grid Tie Inverter with FCU, Installation &amp; Configuration</b>	1	1,62,300.00	1,62,300.00
<b>NARRATION :</b>			<b>SUBTOTAL</b>	<b>1,62,300.00</b>
1. 100% of the Order Value (Rs.1,62,300/-) Delivery and Installation			<b>VAT @ 14.5%</b>	<b>23,534.00</b>
2. VAT at 14.5 % Extra			<b>TOTAL</b>	<b>1,85,834.00</b>

**In Words: One Lakh Eighty Five Thousand Eight Hundred Thirty Four Only**

**TERMS :**

1. Make all DDs payable to : Power Research & Development Consultants Private Limited, Bangalore.
2. 24% Interest is applicable if the bill is not cleared within 15 days.

**Our Bank Account Details**

**IFSC CODE:** CNRB0000886  
**Beneficiary's Bank:** Canara Bank, Mahalakshmi Layout branch, Bangalore - 86  
**Beneficiary's Account Number:** 0886261010300  
**Beneficiary's Account Name:** Power Research & Development Consultants Pvt. Ltd.  
**Beneficiary's Address:** #5, 11th Cross, West of Chord Road, II Stage, Bangalore - 560086, Karnataka, INDIA

Prepared by

Checked by

for POWER RESEARCH & DEVELOPMENT  
CONSULTANTS PVT.LTD.



PRINCIPAL  
Basaveswara Engineering College  
BAGALKOT



BVVS

**Basaveshwar Engineering College (Autonomous)  
Bagalkot – 587102**

Ref. No: BEC/Central Store/ /2022-2023

Date:12/10/2022

To,  
SHRI SAI ELECTRICALS,  
Sector No.31, Shop No.64,  
Stadium Road, Navanagar,  
Bagalkote-587102

**Sir,**

Subject: Supply of **20 W LED Batten Havells tube sets** to BEC, Bagalkot reg....

Ref: Your quotation Dated: 10/10/2022

With reference to the above subject, I would like to place order for the following consumables with your firm.

Sl. No	Particulars	Quantity	Rate	Amount (in Rs)
01	20 W LED Batten Havells tube sets	200	Rs.175/set	35,000.00
			Total	<b>Rs. 35,000.00</b>

(Rupees Thirty Five Thousand only)

( Including GST and transportation extra )

The above consumables may be supplied latest by 14/10/2022 and bill may be prepared in the name of "The Principal, Basaveshwar Engineering College " Bagalkot-587102.

Thank you

Date: 12/10/2022

Place: Bagalkot

Yours faithfully

PRINCIPAL



**PRINCIPAL,**  
Basaveshwar Engineering College  
BAGALKOT



Conera Bank - 298

Head of A/c. Central store consumables

Passed for Rs. 35000=00

Paid by Cheque No. 511539

Date. 14/11/2022 in Favour of  
Sai Electricals, Bagalkot

by Adjustment Rs. ....

✓  
A.A.O

✓  
PRINCIPAL

Recd  
200  
15/11/22

**Certificate**  
This is to certify that the Bill No 814  
Dt 13-10-22 of Rs. 35001=00  
is verified and found correct.  
The items mentioned in invoice are received  
good condition. The details are entered in  
Page no 152 of Purchased day book

S. K. K.  
**Stores Officer**  
**Basaveshwar Engineering College (A)**  
**Central Store**  
**Bagalkot - 587103**



[Signature]  
**PRINCIPAL,**  
**Basaveshwar Engineering College**  
**BAGALKOT**

PRINCIPAL  
Basaveshwar Engineering College  
BAGALKOT

